



EVPÜ[®]

NOTIFIED BODY No. 1293

CERTIFICATE OF CONSTANCY OF PERFORMANCE

No. 1293 – CPR – 0804

In compliance with *Regulation (EU) No 305/2011 of the European Parliament and of the Council of 9 March 2011* (the Construction products Regulation or CPR), this certificate applies to the construction product

Addressable Fire Detection Control Panel AM-8200N

For specifications see Annexes No.1 and 2 to this certificate

placed on the market under the name or trade mark of

Notifier Italia S.r.l.

Via Grandi, 22, 20097 San Donato Milanese (MI), Italy

and produced in the manufacturing plant

IT 00942050287

This certificate attests that all provisions concerning the assessment and verification of constancy of performance described in Annex ZA of the standard(s)


EN 54-2:1997
EN 54-2:1997/AC:1999
EN 54-2:1997/A1:2006
EN 54-4:1997
EN 54-4:1997/AC:1999
EN 54-4:1997/A1:2002
EN 54-4:1997/A2:2006

under system 1 for the performance set out in this certificate are applied and that the factory production control conducted by the manufacturer is assessed to ensure the

constancy of performance of the construction product.

This certificate was first issued on July 13th, 2021 and will remain valid as long as neither the harmonised standard, the construction-product, the AVCP methods nor the manufacturing conditions in the plant are modified significantly, unless suspended or withdrawn by the notified product certification body.

Nová Dubnica, July 13th, 2021
054098



Dušan Novotný
Director NB

Annex No. 1 to Certificate No. 1293 - CPR – 0804 from July 13th, 2021

Technical Specifications

Control and indicating equipment (CIE) consist of components:

Component	Description
AM-8200N	Main board Power supply terminals fused
LIB-8200N	Loop expansion board (2 line drivers, terminals)
GTW-8200	Supervision interface card
AM8-PWR-B	Battery expansion box / Battery expansion module
AM82-BST-C	Amplifier board CAN-BUS


Products parameters:

Main Power Supply: 100÷240V~

Frequency: 50/60Hz

List of optional functions with requirements included in the c.i.e		
Clause	Description	
7.8	Output to the fire alarm device	<input checked="" type="checkbox"/>
7.9.1	Output to fire alarm routing equipment	<input type="checkbox"/>
7.9.2	Alarm confirmation input from fire alarm routing equipment	<input type="checkbox"/>
7.10.1	Output type A	<input checked="" type="checkbox"/>
7.10.2	Output type B	<input type="checkbox"/>
7.10.3	Output type C	<input type="checkbox"/>
7.10.4	Fault monitoring of fire protection equipment	<input checked="" type="checkbox"/>
7.11	Delay to outputs	<input checked="" type="checkbox"/>
7.12.1	Type A dependency	<input type="checkbox"/>
7.12.2	Type B dependency	<input type="checkbox"/>
7.12.3	Type C dependency	<input checked="" type="checkbox"/>
7.13	Alarm counter	<input type="checkbox"/>
8.3	Fault signals from points	<input checked="" type="checkbox"/>
8.4	Total loss of power supply	<input type="checkbox"/>
8.9	Output to fault warning routing equipment	<input type="checkbox"/>
9.5	Disabling of addressable points	<input checked="" type="checkbox"/>
10	Test condition	<input checked="" type="checkbox"/>
11	Standardized input/output interface	<input type="checkbox"/>
Supplementary information: <input checked="" type="checkbox"/> - YES, <input type="checkbox"/> - NO		

Nová Dubnica, July 13th, 2021



Dušan Novotný
Director NB

Annex No. 2 to Certificate No. 1293 - CPR – 0804 from July 13th, 2021

Essential characteristics	Harmonised technical specification		Performance
	EN 54-2:1997 EN 54-2:1997/AC:1999 EN 54-2:1997/A1:2006	EN 54-4:1997 EN 54-4:1997/AC:1999 EN 54-4:1997/A1:2002 EN 54-4:1997/A2:2006	
Performance under fire conditions	cl. 4, 5, 7	-	Pass
Performance of power supply	-	cl. 4, 5, 6	Pass
Response delay (response time to fire)	cl. 7.1, 7.7, 7.11, 7.12	-	Pass
Operational reliability	cl. 4 to 10, 11=N/A, 12 to 14	cl. 4 to 8	Pass
Durability of operational reliability: temperature resistance	cl. 15.4	cl. 9.5	Pass
Durability of operational reliability: vibration resistance	cl. 15.6, 15.7, 15.15	cl. 9.7, 9.8, 9.15	Pass
Durability of operational reliability: electrical stability	cl. 15.8, 15.9 to 15.12=N/A, 15.13	cl. 9.9, 9.10 to 9.13=N/A	Pass
Durability of operational reliability: humidity resistance	cl. 15.5, 15.14	cl. 9.6, 9.14	Pass



Nová Dubnica, July 13th, 2021
054099

Dušan Novotný
Director NB

EVAP

EVAP

EVPU, s.p. a.
Nulłed Body No 1288
ICA

EVAP


EVAP

EVAP

EVAP

EVAP

EVAP

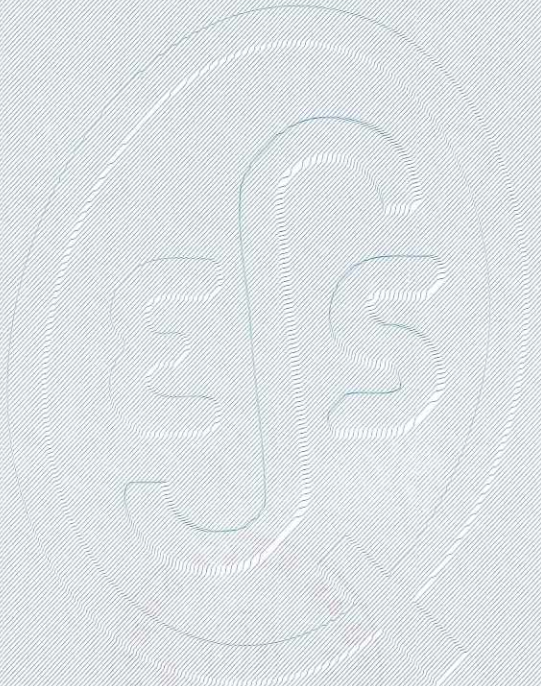

EVAP

EVAP